

System No. FF-S-0022


December 24, 1996

Assembly Rating – 2 Hr

Joint Width – 2 In. Maximum

L Rating At Ambient – Less Than 1 CFM/Lin Ft

L Rating At 400° F – Less Than 1 CFM/Lin Ft
(UL/cUL)

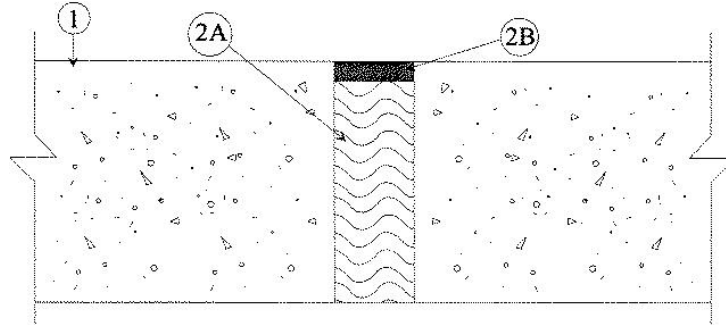

1. **Floor Assembly** Min 4-1/2 in. thick reinforced lightweight or normal weight (100-150 pcf) structural concrete.
2. **Joint System** Max width of joint is 2 in. The joint system shall consist of the following:
 - A. **Packing Material** Min 4 in. thickness of min 2.5 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor as required to accommodate the required thickness of fill material.
 - B. **Fill, Void or Cavity Material*** Min 1/2 in. wet thickness of fill material applied within the joint, flush with top surface of floor.

TREMCO INC – TREMstop Acrylic

*Bearing the UL Classification Mark



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.
Copyright © 2008 Underwriters Laboratories Inc. ®