


## System No. FF-S-0023

October 01, 2004

Assembly Rating — 3 Hr

Joint Width — 2 In. Maximum  
(UL/cUL)

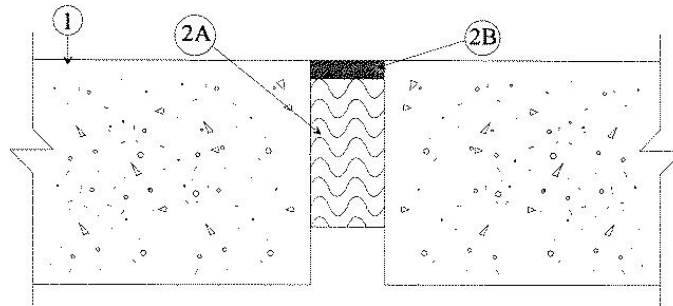

1. **Floor Assembly** Min 6 in. thick reinforced lightweight or normal weight (100-150 pcf) structural concrete.
2. **Joint System** Max width of joint is 2 in. The joint system shall consist of the following:
  - A. **Packing Material** Min 4 in. thickness of min 2.5 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor as required to accommodate the required thickness of fill material.
  - B. **Fill, Void or Cavity Material\*** Min 1/2 in. thickness of fill material applied within the joint, flush with top surface of floor.

TREMCO INC — Fyre-Sil S.L. and Fyre-Sil

\*Bearing the UL Classification Mark



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.  
Copyright © 2008 Underwriters Laboratories Inc. ®