

System No. FF-S-0029

October 01, 2004


F Rating - 2 Hr

L Rating at Ambient - Less than 1 CFM/Lin. Ft.

L Rating at 400°F - Less than 1 CFM/Lin. Ft.

Joint Width - 2 In. Max

(UL/cUL)

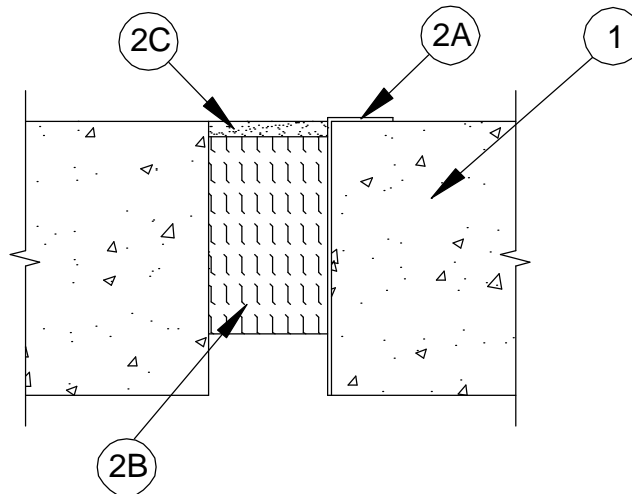

1. **Floor Assembly** - Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf (1600-2400 kg/cu meter)) structural concrete.
2. **Joint System** - Max width of joint is 2 in. (51 mm). The joint system shall consist of the following:
 - A. **Membrane*** Self-adhesive membrane cut to min 5-1/2 in. (140 mm) width and applied to one inside of joint, flush with bottom of joint and overlapping min 1 in. onto top surface of floor. Adjoining lengths of membrane to be provided with max 2 in. (50 mm) end laps spaced min 40 in. (1016 mm) apart along length of joint.
HENRY CO. - Blueskin SA or SA-LT
 - B. **Packing Material*** Min 4.0 pcf (64 kg/cu meter) mineral wool insulation installed in joint opening as a permanent form. Pieces of batt cut to min width of 4 in. (102 mm) and installed edge-first into the joint opening, parallel with the joint direction, such that batt sections are compressed min 50 percent in thickness and that the compressed batt sections are recessed from top surface of floor as required to accommodate the required thickness of fill material. Adjoining lengths of batt to be tightly-buttet with butted seams spaced min 36 in. (914 mm) apart along the length of the joint.
FIBREX INSULATIONS INC – FBX Safing Insulation
ROCK WOOL MANUFACTURING CO – Delta Safing Board
 - C. **Fill, Void or Cavity Material*** (Caulk) – Min 1/4 in. (6 mm) thickness of fill material applied within the joint, flush with top surface of floor.
TREMCO INC – Fyre-Sil

*Bearing the UL Classification Mark



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.
Copyright © 2008 Underwriters Laboratories Inc. ®