

System No. WW-S-0024

October 04, 2000


Assembly Rating – 2 Hr

Joint Width – 2 In. Maximum

L Rating At Ambient – Less Than 1 CFM/Lin Ft

L Rating At 400 F – Less Than 1 CFM/Lin Ft

(UL/cUL)

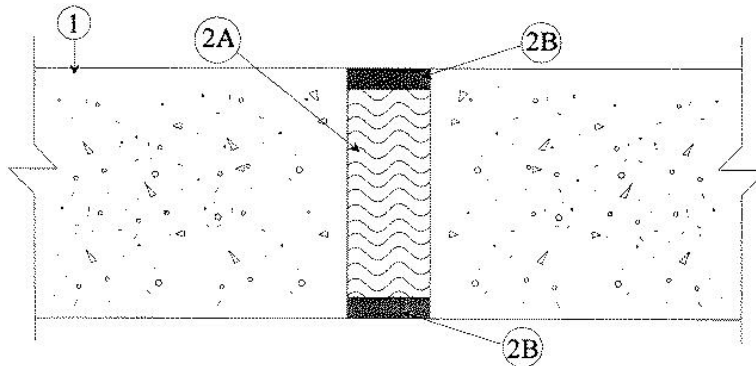

1. **Wall Assembly** Min 5 in. thick reinforced lightweight or normal weight (100 - 150 pcf) structural concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Joint System** Max width of joint is 2 in. The joint system shall consist of the following:

- A. **Packing Material** Min 4 in. thickness of min 2.5 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from each surface of wall as required to accommodate the required thickness of fill material.
- B. **Fill, Void or Cavity Material*** Min 1/2 in. wet thickness of fill material applied within the joint, flush with each surfaces of wall.

TREMCO INC – TREMstop Acrylic

*Bearing the UL Classification Marking



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.
Copyright © 2008 Underwriters Laboratories Inc. ®