


System No. WW-S-0025

October 01, 2004

Assembly Rating — 3 Hr

Joint Width — 2 in. Maximum
(UL/cUL)

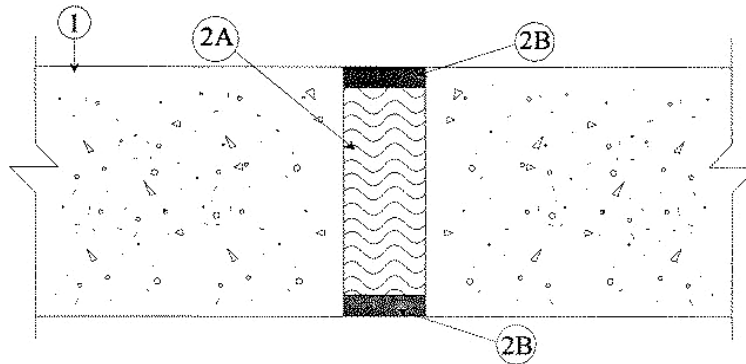

1. **Wall Assembly** — Min 6 in. thick reinforced lightweight or normal weight (100 - 150 pcf) structural concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***.
See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.
2. **Joint System** — Max width of joint is 2 in. The joint system shall consist of the following:
 - A. **Packing Material** — Min 4 in. thickness of min 2.5 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from each surface of wall as required to accommodate the required thickness of fill material.
 - B. **Fill, Void or Cavity Material*** — Min 1/2 in. thickness of fill material applied within the joint, flush with each surface of wall.

TREMCO INC — Fyre-Sil

*Bearing the UL Classification Mark



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.
Copyright © 2008 Underwriters Laboratories Inc. ®