


System No. F-A-2029

August 2008
F Rating – 2 Hr
T Rating – 1-1/2 Hr
(UL/cUL)

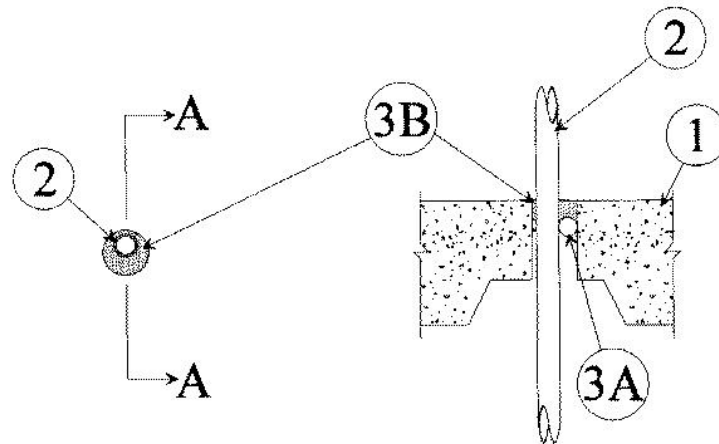

SECTION A-A

1. **Floor Assembly** The fire-rated unprotected concrete and steel floor assembly shall be constructed of the materials and in the manner specified in the individual D900 Series designs in the UL Fire Resistance Directory and as summarized below:
 - A. **Normal Weight or Lightweight Concrete** Min 3-1/2 in. thickness of normal weight concrete with carbonate or siliceous aggregate, 145 to 155 pcf unit weight, min 3000 psi compressive strength. Min 3-1/2 in. thickness of lightweight concrete with expanded shale, clay or slate aggregate, 105 to 115 pcf unit weight, min 3000 psi compressive strength.
 - B. **Welded Wire Fabric** 6 x 6 -W1.4 x W1.4.
 - C. **Steel Floor and Form Units*** Composite or noncomposite 2 in. deep fluted galv units as specified in the individual Floor-Ceiling design. Max diam of opening cored-drilled through floor assembly is 2 in.
2. **Nonmetallic Pipe** Nom 1 in. diam (or smaller) Schedule 40 polyvinyl chloride (PVC) pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems. One pipe to be installed either concentrically or eccentrically within the firestop system. The annular space shall be a min 1/4 in. to max 7/16 in. Pipe to be rigidly supported on both sides of floor assembly.
3. **Firestop System** The firestop system shall consist of the following:
 - A. **Packing Material** Foam backer rod firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor as required to accommodate the required thickness of fill material.
 - B. **Fill, Void or Cavity Material* – Caulk** Min 1 in. thickness of fill material applied within the annulus, flush with top surface of floor.

TREMCO INC – TREMstop Intumescent Acrylic, FyreCaulk, or TREMstop IA+

*Bearing the UL Classification Mark



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.
Copyright © 2008 Underwriters Laboratories Inc. ®