

System No. W-J-5096


August 2008

F Rating — 2 Hr

T Ratings — 0, 1/2 and 1 Hr (See Item 5)

Leakage Rating at Ambient — Less Than 1 CFM/sq ft

(UL/cUL)

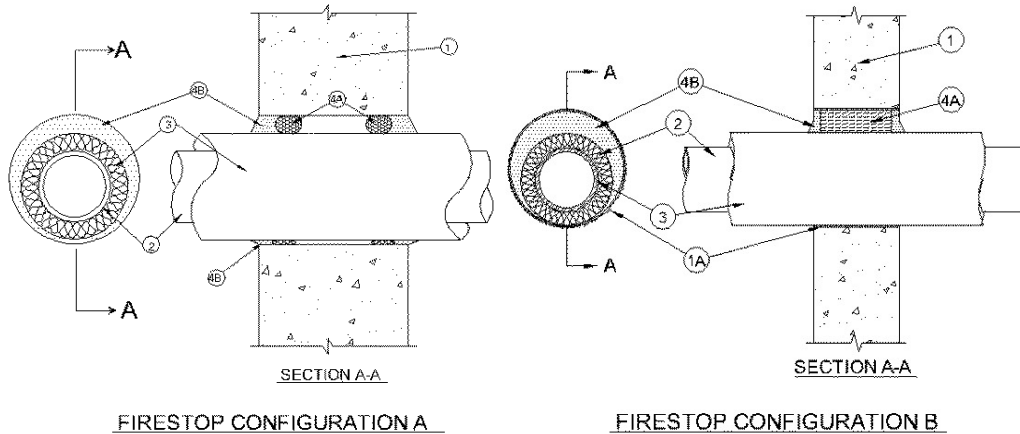

1. **Wall Assembly** — Min 6 in. (152 mm) thick reinforced lightweight or normal weight (100-150 pcf (1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 12 in. (305 mm).
See **Concrete Blocks (CAZT)** category in the Fire Resistance Directory for names of manufacturers.
- 1A. **Steel Sleeve** — (See Table in Item 4.) Nom. 8 in. (203 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe sleeve friction fit in wall assembly, or max 12 in. (305 mm) diam cylindrical sleeve fabricated from min 0.013 in. (0.33 mm) to max 0.056 in. (1.4 mm) thick galv steel sheet and having a min 1 in. (25 mm) lap along the longitudinal seam. Length of sleeve flush with both walls. Cylindrical sleeve to be installed by coiling the sheet metal to a diam smaller than the through opening, inserting the coil through the opening and releasing the coil to let it uncoil against the circular cutout in the wall.
2. **Through Penetrants** — One metallic pipe or tubing to be installed either concentrically or eccentrically within the firestop system. Pipe or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes or tubing may be used:
 - A. **Steel Pipe** — Nom 8 in. (203 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
 - B. **Iron Pipe** — Nom 8 in. (203 mm) diam (or smaller) cast or ductile iron pipe.
 - C. **Copper Tubing** — Nom 4 in. (102 mm) diam (or smaller) Type L (or heavier) copper tubing.
 - D. **Copper Pipe** — Nom 4 in. (102 mm) diam (or smaller) Regular (or heavier) copper pipe.
3. **Pipe Covering*** — Nom 1 in. (25 mm) thick hollow cylindrical heavy density (min 3.5 pcf or 56 kg/m³) glass fiber units jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product. See Table in Item 4 for annular space required between insulated penetrant and periphery of opening.
See **Pipe and Equipment Covering-Materials (BRGU)** category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.
4. **Firestop System** — The firestop system shall consist of the following:
 - A. **Packing Material** — (Optional, See Table in Item 4) — Foam backer rod firmly packed into the opening as a permanent form. Packing material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material.
 - A1. **Packing Material** — (See Table in Item 4) Min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material.

- B. **Fill, Void or Cavity Material* – Caulk** – Fill material applied within the annulus, flush with both surfaces of wall or overlapping min 1/4 in. onto wall surfaces when the steel sleeve is used. See Table below for min thickness of fill material. Additional fill material to be installed such that a min 3/8 in. (10 mm) crown is formed around the penetrating item.

TREMCO INC – TREMstop Intumescent Acrylic, FyreCaulk, or TREMstop IA+

Sleeve	Packing Matl	Min Annular	Max Annular	Min Fill Matl Thick	T Rating
None	Opt Foam Backer	1/4 in. (6 mm)	1-1/4 in. (32 mm)	1 in. (25 mm)	1 hr
Sch 10	Mineral Wool	0 in. (point contact)	1-9/16 in. (40 mm)	1/2 in. (13 mm)	0 hr
Cylindrical	Mineral Wool	0 in. (point contact)	1-9/16 in. (40 mm)	1/2 in. (13 mm)	0 hr
Cylindrical	Opt Foam Backer	0 in. (point contact)	1-3/8 in. (35 mm)	5/8 in. (16 mm)	1/2 hr

*Bearing the UL Classification Mark



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.
Copyright © 2008 Underwriters Laboratories Inc. ®

Tremco Commercial Sealants & Waterproofing

3735 Green Road, Beachwood, OH 44122 // Phone: 216.292.5000 // 800.321.7906
220 Wicksteed Avenue, Toronto, ON M4H 1G7 // Phone: 416.421.3300 // 800.363.3213
1451 Jacobson Avenue, Ashland OH 44805 // Phone: 419.289.2050 // 800.321.6357