


System No. W-J-5097

August 2008
 F Rating — 2 Hr
 T Rating — 2 Hr
 (UL/cUL)

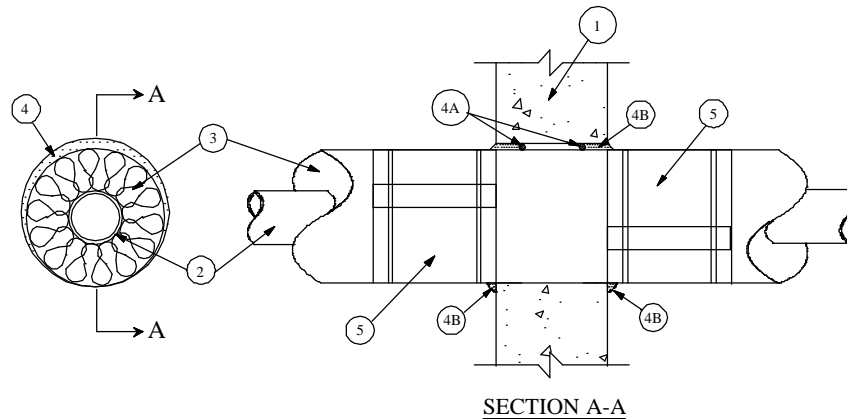

1. **Wall Assembly** — Min 6 in. (152 mm) thick reinforced lightweight or normal weight (100-150 pcf (1601-2402 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 15-1/8 in. (385 mm).
 See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.
2. **Through Penetrants** — One metallic pipe or tubing to be installed either concentrically or eccentrically within the firestop system. Pipe or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes or tubing may be used:
 - A. **Steel Pipe** — Nom 8 in. (203 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
 - B. **Iron Pipe** — Nom 8 in. (203 mm) diam (or smaller) cast or ductile iron pipe.
3. **Pipe Covering Materials* — Cellular Glass Insulation** — Nom 3 in. (76 mm) thick cellular glass units sized to the outside diam of the through penetrant and supplied in nom 24 in. (610 mm) long half sections or nom 18 in. (457 mm) long segments. Pipe insulation installed in accordance with the manufacturer's instructions. The annular space between the insulated pipe and periphery of opening shall be min 0 to max 1/2 in. (12 mm).
PITTSBURGH CORNING CORP — FOAMGLAS
4. **Firestop System** — The firestop system shall consist of the following:
 - A. **Packing Material** — (Optional) — Foam backer rod firmly packed into the opening as a permanent form. Packing material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material.
 - B. **Fill, Void or Cavity Material* — Caulk** — Min 1 in. (25 mm) thickness of fill material applied within the annulus, flush with both surfaces of wall. Additional fill material to be installed such that a min 5/8 in. (16 mm) crown is formed around the penetrating item on both surfaces of wall.
TREMCO INC — TREMstop Intumescent Acrylic, FyreCaulk, or TREMstop IA+
5. **Metal Jacket** — Min 10 in. (254 mm) wide jacket formed of min 0.010 in. (0.254 mm) thick aluminum sheet tightly wrapped around the outer circumference of the pipe insulation (Item 3) with a min 2 in. (51 mm) lap. Jacket secured with min 1/2 in. (12 mm) wide stainless steel hose clamps or bands located within 2 in. (51 mm) of each end of the jacket and spaced a max of 8 in. (203 mm) OC. Jacket to be installed abutting surface of caulk (Item 4) on both surfaces of wall. Metal jacket to be used in addition to any other jacketing material which may be required or desired on the pipe insulation.

*Bearing the UL Classification Mark



Reprinted from the Online Certifications Directory with permission from Underwriters Laboratories Inc.
 Copyright © 2008 Underwriters Laboratories Inc. ®